




International Journal of Mechanical Engineering Research and Technology

ISSN 2454-535X

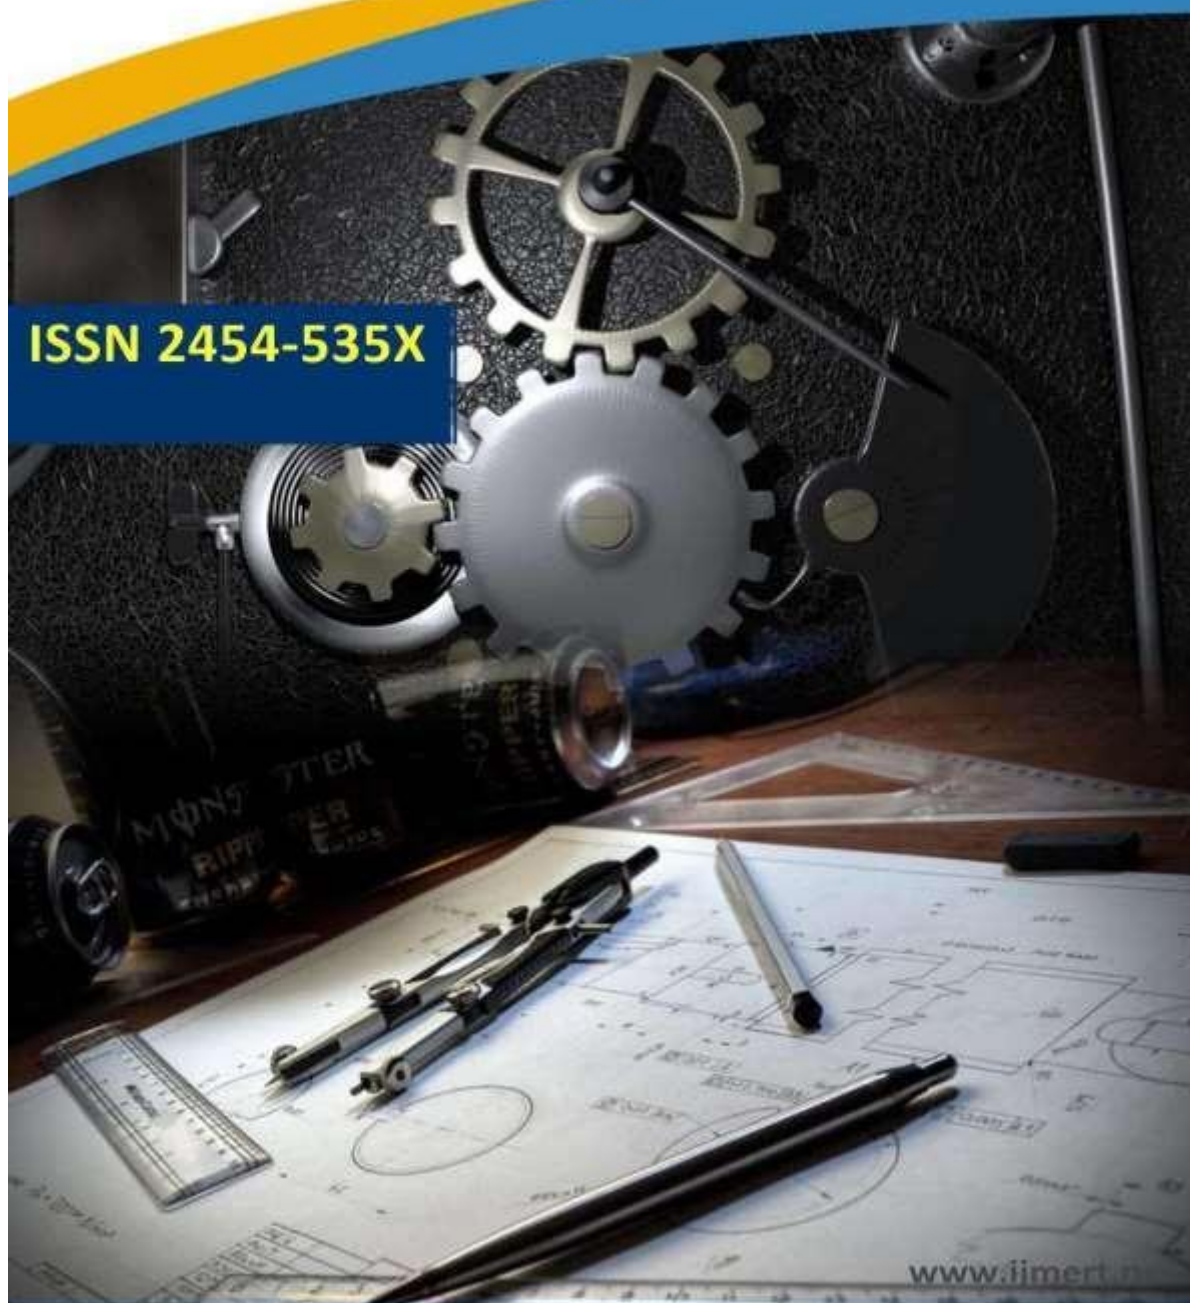

www.ijmert.in

Email ID: info.ijmert@gmail.com or editor@ijmert.net



A Study on Cooling and Dehumidification Process of a HeatPump Drying System at Low Temperature

Santosh¹, Rajendra², Varun³ & Sandeep⁴

[†]School of Heat Engineering and Refrigeration, Hanoi University of Science and Technology, No.1, Dai Co Viet Road, Hanoi 10000, Vietnam

[‡]Center for Micro Electronics and Information Technology, No. 25, Le Thanh Tong Street, Hanoi 10000, Vietnam

*E-mail: skh@hust.edu.vn

ABSTRACT:

When compared to the traditional drying process, the low-temperature heat pump drying technology has gained popularity since it improves product quality in postharvest settings. Moist air passing through evaporator coils is cooled and dehumidified, which primarily affects the heat pump dryer's efficiency. However, there aren't any relationships between mass and heat transport to help solve the issues. This work presents initial efforts to bridge the gaps in the heat and mass transfer problem. Basic equations for mass and energy are used to create a mathematical model. The Taylor series approach was utilized to solve the model's numerical solutions. The study's findings include the steady-state dehumidification of damp air using simple tube coils.

INTRODUCTION

Compared to traditional dryers, heat pump dryers may be able to run more effectively and at lower temperatures. The utilization of heat pumps in drying processes has garnered ongoing interest due to its dual advantages. Moisture moves from the product's inside to its surface as a result of the vapour pressure or moisture concentration gradient that is formed when hot air, either naturally occurring or manufactured, is applied to the product. The product's quality eventually deteriorates due to physical and chemical changes brought on by too high drying temperatures [1]. Certain materials, like medicinal and aromatic plants, are sensitive to heat and should be dried carefully to preserve the product's intended medicinal and aromatic characteristics..

MODELING OF THE COOLING AND DEHUMIDIFICATION

Objectives

Fig. 1 shows the mechanism of heat and mass transfer when moist air moves through cold water outside of a tube. On top of the cold-water surface, a thin layer of saturated (or near saturated) moist air is formed. As the water is colder, the layer has saturated vapor pressure lower than vapor pressure of the air. The difference between these pressures causes water to be condensed onto the colder water surface.

In order to establish a model, the following assumptions have been made as follows:

- Thermal properties of moist air are constant
- Steady state
- The model is one-dimensional (refrigerant boils at the given temperature, i.e. $t_r = \text{const}$)
- Thermal resistance of condensate water is negligible.
- Heat infiltration from the environment is ignored.

The main purpose of the model is to investigate the change of thermodynamics properties of the air (e.g. temperature, humidity, etc), while varying the external conditions along the coil and to subsequently determine the air's outer parameters values.

Heat and mass transfer equations

Considering air flow exchanges energy to a cold water surface (i.e. Fig. 1). On top of the cold water surface, a

thin layer of saturated (or near saturated) moist air is formed. Since the water is colder, the layer being saturated vapor pressure is lower than that of the air. The difference of the two partial pressure causes water to be condensed on the tube's surface [7-10].

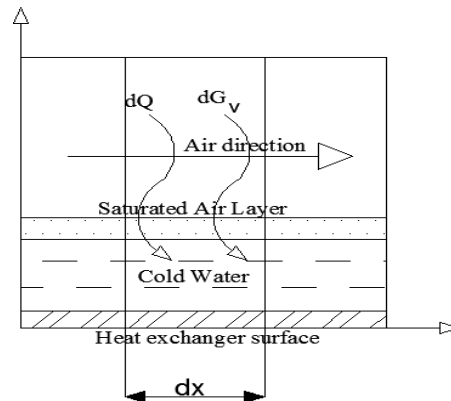


Figure 1. Heat and mass transfer mechanism of moist air outside the tube.

The air is cooled by 2 ways. One is by convective heat transfer caused by the temperature differences between the air and the water surface, and another one is due to latent heat by water condensation.

Mass transfer equation

The equation of mass transfer can be written in term of partial pressure:

$$dG_v = -\beta(WW - W_s)dF \quad (1.1)$$

To address to the x -coordinate, we introduce function $ff(x)$:

$$ff(x) = \frac{dF(x)}{dx} \quad (1.2)$$

Ignoring the thermal resistance of the condensate film, the temperature of the coil's outer surface is assumed being equal to the condensate layer surface temperature. The relationship can be shown by the Antoine expression:

$$P_s = \exp \left(12 - \frac{4026.4}{t_{ww} + 235.5} \right) \quad (1.3)$$

Absolute humidity ratio air flow is calculated by the formula (number 0.95 means that the layer is only in 95% saturated condition)

$$W_s = 0.621 \frac{0.95 P_s}{P_a - 0.95 P_s} \quad (1.4)$$

Combine equations (2.2) and (2.4) to (2.1), with $W = G_v/G_d$ the mass transfer equation is read:

$$\frac{dG_v}{dx} = -\beta \frac{A}{G_d} - 0.621 \frac{0.95 \exp \left(12 - \frac{4026.4}{t_{ww} + 235.5} \right)}{P_a - 0.95 \exp \left(12 - \frac{4026.4}{t_{ww} + 235.5} \right)} f(x) \quad (1.5)$$

Heat transfer equation

Heat transfer is caused by the change of the air flow enthalpy:

$$dQ = G_d dh \quad (2.1)$$

From the left side of the equation (2.6):

$$dQ = -\alpha_1 (t - t_{ww}) dF + r dG_v \quad (2.2)$$

The first term of the equation (2.7) is sensible heat transferred by convection and the second one is latent heat of condensation process.

The right side of equation can be written by the specific enthalpy dh :

$$G_d dh = G_d C_{pd} dt + r \frac{dG_v}{G_d} + C_{pv} t \frac{dG_v}{G_d} + C_{pd} dt \frac{G_v}{G_d} \quad (2.3)$$

Substituting equations (2.7) and (2.8) into equation (2.6), with $dF = f(x)dx$ and then simplifying to get the following equation:

$$\frac{dt}{dx} = \frac{-\alpha_1 (t - t_{ww}) f(x) - C_{pv} t \frac{dG_v}{dx}}{G_d C_{pd} + G_v C_{pv}} \quad (2.4)$$


Heat balance

In the model the equations are derived by balancing heat transferred from the air to the coil outer surface and from there to refrigerant boiling inside of the coil:

$$k_{a2}(t_{ww} - t_r)dF = \alpha_1(t - t_{ww})dF - rdG_h \quad (3.1)$$

We change equation (2.10) to the algebraic form as:

$$\begin{aligned}
 & \frac{1}{\alpha_2} t \\
 & \frac{\alpha + k}{\beta} \frac{0.621}{t_{ww} + 235.5} \\
 & \frac{\bar{\sigma}_v - \beta}{t} \frac{\alpha_1}{\alpha} t \quad (3.2) \\
 & \frac{0.95 \exp\left(12 - \frac{4026.4}{t_{ww} + 235.5}\right)}{-0.95 \exp\left(12 - \frac{4026.4}{t_{ww} + 235.5}\right)}
 \end{aligned}$$

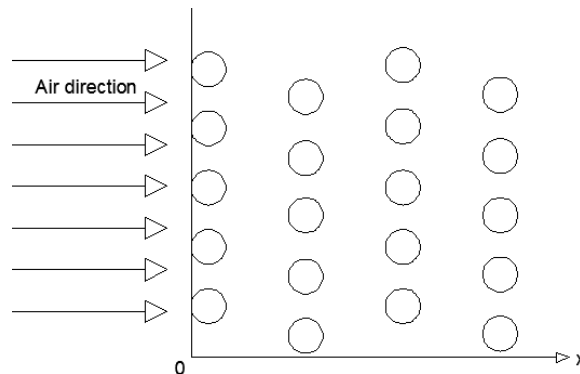**Figure 2.** Configuration of the coil and air direction

In the case plain tube coil the function $f(x)$ can be written as:

$$f(x) = \begin{cases} 2Rnl \frac{1}{R - 2(k-1)R + (k-1)s - x} & \forall (2(k-1)R + (k-1)s \leq x \leq 2kR + (k-1)s) \\ 0 & \forall (2kR + (k-1)s \leq x \leq 2kR + ks) \end{cases} \quad (4)$$

Boundary condition

The boundary condition is the air temperature and absolute humidity before entering the coil: $G_v(x=0)$ and $t(x=0)$.

Numerical solution

The differential equations were solved numerically by the Taylor series method with the 1st degree of accuracy and simulated by the Matlab software:

$$G(x+h) = G(x) + \Delta x \frac{dG_v}{dx} \quad (6.1)$$

$$t(x+h) = t(x) + \Delta x \frac{dt}{dx} \quad (6.2)$$

A flow chart of the basic calculation procedure in the model of the heat and mass transfer with moist air as working fluid is presented in Fig. 3.

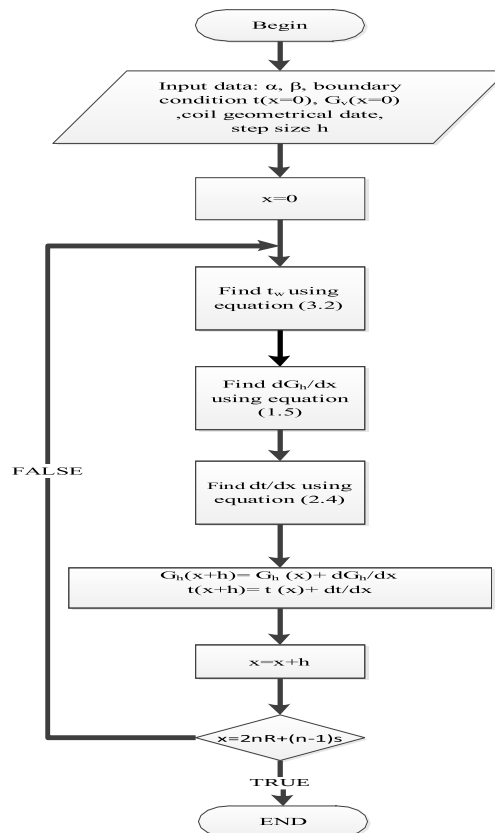


Figure 3. Flowchart of the simulation program

RESULTS AND DISSCUSIONS

Inputs of the model

The inputs parameters given in Table 1 and 2 have been kept constant. The model has been investigated for two example cases. The variation of several quantities along the flow length with different inputs has been studied.

Table 1. Input of the model for the 1st case.

No.	Parameter	Unit	Value
1	Air inlet temperature	°C	32
2	Air inlet relative humidity	%	50
3	Air inlet mass flow rate	kg/s	0.05
4	Tube's outer diameter	cm	1
5	Length of tube each row	m	0.5
6	Number of tubes each row	-	6
7	Number of rows	-	6
8	Distance between two row	cm	3
9	Refrigerant boiling temperature	°C	3
10	Air-side heat transfer coefficient	W/m ² K	60
11	Mass transfer coefficient	kg/m ² s	0.086
12	Overall heat transfer coefficient of tube and refrigerant	W/m ² K	1000

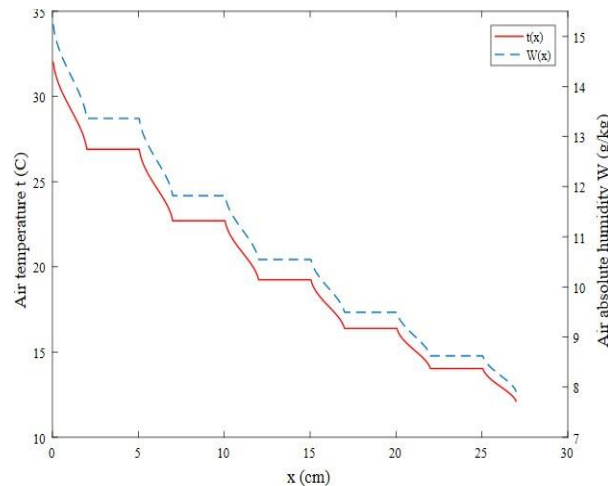


Figure 4. Variation of absolute humidity and temperature of moist air along the coil for the 1st case.

Fig. 4 and 5 present the change of the parameters: air temperature and absolute humidity when air goes through the evaporator coil with different input data. Generally speaking, both cases have a similar trend. At the same time, the temperature and humidity behaviors (i.e. $t(x)$ and $WW(x)$) from each case are both similar and equivalent to another one.

Table 2. Input of the model for the 2nd case.

No.	Parameter	Unit	Value
1	Air inlet temperature	°C	25
2	Air inlet relative humidity	%	60
3	Air inlet mass flow rate	kg/s	1
4	Tube's outer diameter	cm	1
5	Length of tube each row	m	1
6	Number of tubes each row	-	16
7	Number of rows	-	20
8	Distance between two row	cm	2
9	Refrigerant boiling temperature	°C	2
10	Air-side heat transfer coefficient	W/m ² K	60
11	Mass transfer coefficient	kg/m ² s	0.086
12	Overall heat transfer coefficient of tube and refrigerant	W/m ² K	1000

As the air moves through the coil, both temperature and specific humidity line reduce upwards to x . The decrease is non-continuous. Temperature and humidity of the air flow decrease only while staying in contact with the coil's outer surface (i.e. $ff(x) \neq 0$). In the empty region between two rows ($ff(x) = 0$), these parameters remain constant. In the regions in which the heat and mass transfer occurs under the effect of function $ff(x)$, the temperature and humidity graph's slope gradually decline from 90° to minimum at the center of the tube center, before increasing again to 90° at the end of the tube. However, the slope does not increase again after the tube's center, once the heat and mass transfer became less effective due to the flow mechanics. The obtained result is due to the assumption heat and mass transfer coefficient being constant with coordinate of x .

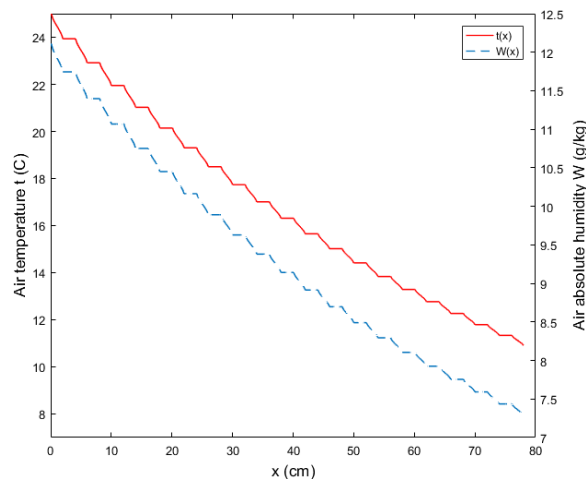


Figure 5. Variation of absolute humidity and temperature of moist air along the coil for the 2nd case.

Furthermore, both $t(x)$ and $W(x)$ curves (when decrease) are steeper in area nearer to the base point than posterior area (for instance, in the 1st case, the temperature drops in the 1st row is 5 °C, while in the last row is 1.6 °C). This can be explained as the further the air flows inside the coil, the colder and the drier the air achieved, which cause temperature and humidity differences between the air and the coil's surface to be decreased as well. Since both these two differences are two main factors behinds heat and mass transfer process, their decrease cause heat/mass transfer to be less effective than before. This effect cause both the $t(x)$ and $W(x)$ have the forms relatively similar to the exponential function curve, which is commonly found in the open literature.

CONCLUSIONS

The heat and mass transfer in the evaporator (dehumidifier) has been studied in this work for a better understanding of the phenomena in the heat pump dryers. Based on the fundamental equations of heat and mass balances, a mathematical model was established. The model has the advantage of being simple and compact, and thus, requires a short simulation time. Some different cases have been investigated as changing the input data for the model. The results

show the temperature and absolute humidity behaviors changing with different factors when it is cooled and dried through the coils of the evaporator. Nevertheless, several assumptions are made at the cost of accuracy, especially the constant heat and mass transfer coefficient assumption. The other cases such as the dehumidification at finned-tube coils and dehumidification with air frost at the transient state will be shown in next papers.

ACKNOWLEDGEMENTS

This research is funded by the Ministry of Science and Technology (MOIST) under project number 07/2019/HĐ-ĐTCB. The authors are thankful to MOIST, who support financial and material facilities of this work.

NOMENCLATURE

G	Mass flow rate (kg/s)
W	Absolute humidity (kg/kg)
β	Mass transfer coefficient (kg/m ² s)
F	Coil's outer surface area (m ²)
t	Temperature (°C)
ϕ	Relative humidity (%)
h	Specific enthalpy (J/kg)



c_p	Specific heat (J/kg·K)
r	Latent heat (J/kg)
α_1	Heat transfer coefficient of air (W/m ² K)
k_{o2}	Overall heat transfer coefficient of refrigerant and tube (W/m ² K)
Δx	Calculation step size (mm)
R	Tube outer radius (m)

- n Number of tubes each row
 l Tube's length each row (m)
 s Distance between 2 rows (m)
 N Number of rows

Subscripts

- $-$ Moist air flow
 s Saturated moist air layer
 v Water vapor
 d Dry air
 w Coil's surface
 r Refrigerant

REFERENCES

- [1] B. K. Bala. Drying and Storage of Cereal Grains. New Delhi: Oxford and IBH Publishing Co. Pvt. Ltd, 1997.
- [2] M.A. Hossain, K. Gottschalk, M.S. Hassan. "Mathematical model for a heat pump dryer for aromatic plant". *Procedia Engineering*, vol. 56, pp. 510 – 520, 2013.
- [3] A. Zada, H. Ullah. "Decomposition of Cm Through Q-Periodic Discrete Evolution Family". *Matrix Science Mathematic*, vol. 3, no. 1, pp. 09-12, 2019.
- [4] P. Umamaheswarrao, D. R. Raju, Kns Suman, B. R. Sankar. "Topsis Based Optimization of Process Parameters While Hard Turning of Aisi 52100 Steel". *Acta Mechanica Malaysia*, vol. 2, no. 2, pp. 28-31, 2019. DOI: 10.26480/amm.02.2019.28.31
- [5] H. Enshasy, Q.A. Al-Haija, H. Al-Amri, M. Al-Nashri, S. Al-Muhaisen. "A Schematic Design of HHO Cell as Green Energy Storage". *Acta Electronica Malaysia*, vol. 3, no. 2, pp. 09-15, 2019.
- [6] X.G. Yue, M.A. Ashraf. "Analysis of The Function Relations Between the Depth of Gap or Slot and The Speed of Vibration in Millisecond Multiple-Row Holes Blasting". *Engineering Heritage Journal*, vol. 2, no. 1, pp. 01-04, 2018.
- [7] S. Prasertsan, P. Saen-Saby, P. Ngamsritrakul, G. Prateepchaikul. "Heat pump dryer Part 1: Simulation of the models". *International Journal of Energy Research*, vol. 20, pp. 1067–1079, 1996.
- [8] J. Sarkar, S. Bhattacharyya, M. R. Gopal. "Transcritical CO₂ Heat Pump Dryer: Part 1. Mathematical Model and Simulation". *Drying Technology*, vol. 24, pp. 1583–1591, 2006.
- [9] M. K. Mansour, M. Hassab. Thermal Design of Cooling and Dehumidification Coil. *InTech Open*, 2012.
- [10] D. Q. Phu, T. T. Son, T. V. Phu. "Heat Transfer". Ministry of Education Publisher, Hanoi, 2004.